


# P180-52-21

REV. 11/06

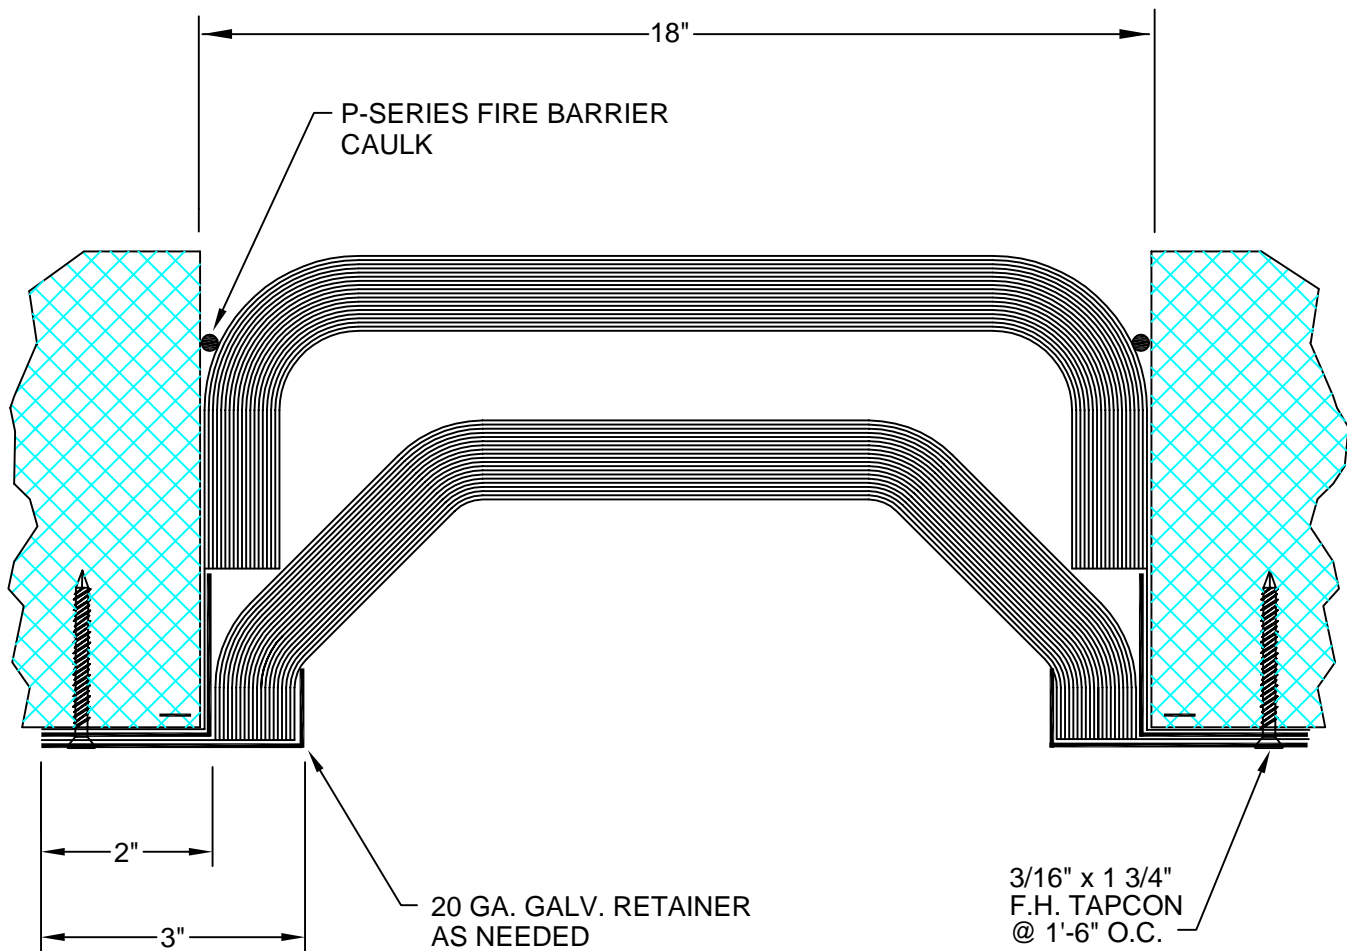

WALL TO WALL / CEILING TO CEILING FIRE BARRIER  
 MAX. OPEN 36"  
 2 HOUR RATED  
 CONTACT FACTORY FOR ADDITIONAL INFORMATION

CUSTOMER:		
PROJECT:		
LOCATION:		
ARCHITECT:		
CONTRACTOR:		
NOTE:		
JOB NO.:	DATE:	SCALE: (NTS)

LENGTH:	QTY:	LOCATION: